

CPVC PIPE HANGER SUPPORT
DOUBLE OFFSET CPVC HANGER



Hanger for horizontal CPVC piping when installed on the side of supporting structure.




Designed to mount CPVC pipe horizontally to wood or composite wood joists with a minumum 3/8" thickness.

- Carbon Steel Construction
- Electro Galvanized Finish
- Supplied with hex head cap screws
- Bottom of pipe is offset 1-1/2" from structure.
Eliminates spacer blocks
- Offset beveled edge eliminates abrasion
- Suitable for fire protection installations
- Sizes 3/4" (20 mm) and 1" (25 mm)
- UL Listed File EX6587



Installation instructions

- Slide CPVC Pipe through the Double Offset Hanger
- Secure the hanger to the supporting structure with screws provided
- Install screws until they bottom out.

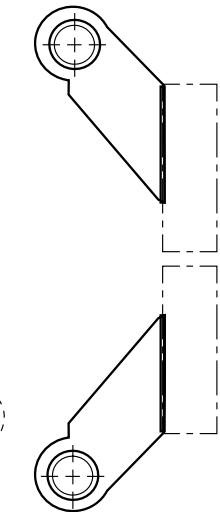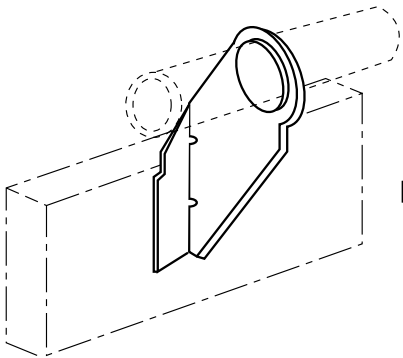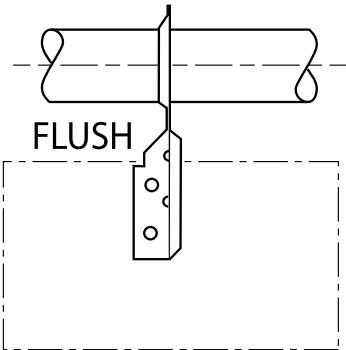


DOUBLE OFFSET

ITEM #	DESCRIPTION
2530181-3/4	3/4" Double Offset CPVC Hanger
2530181-1	1" Double Offset CPVC Hanger

System No.		Location		Spec Section		Paragraph	
Submitted By		Date		Approved		Date	

CPVC PIPE HANGER SUPPORT
DOUBLE OFFSET CPVC HANGER • 3/4" SIZE

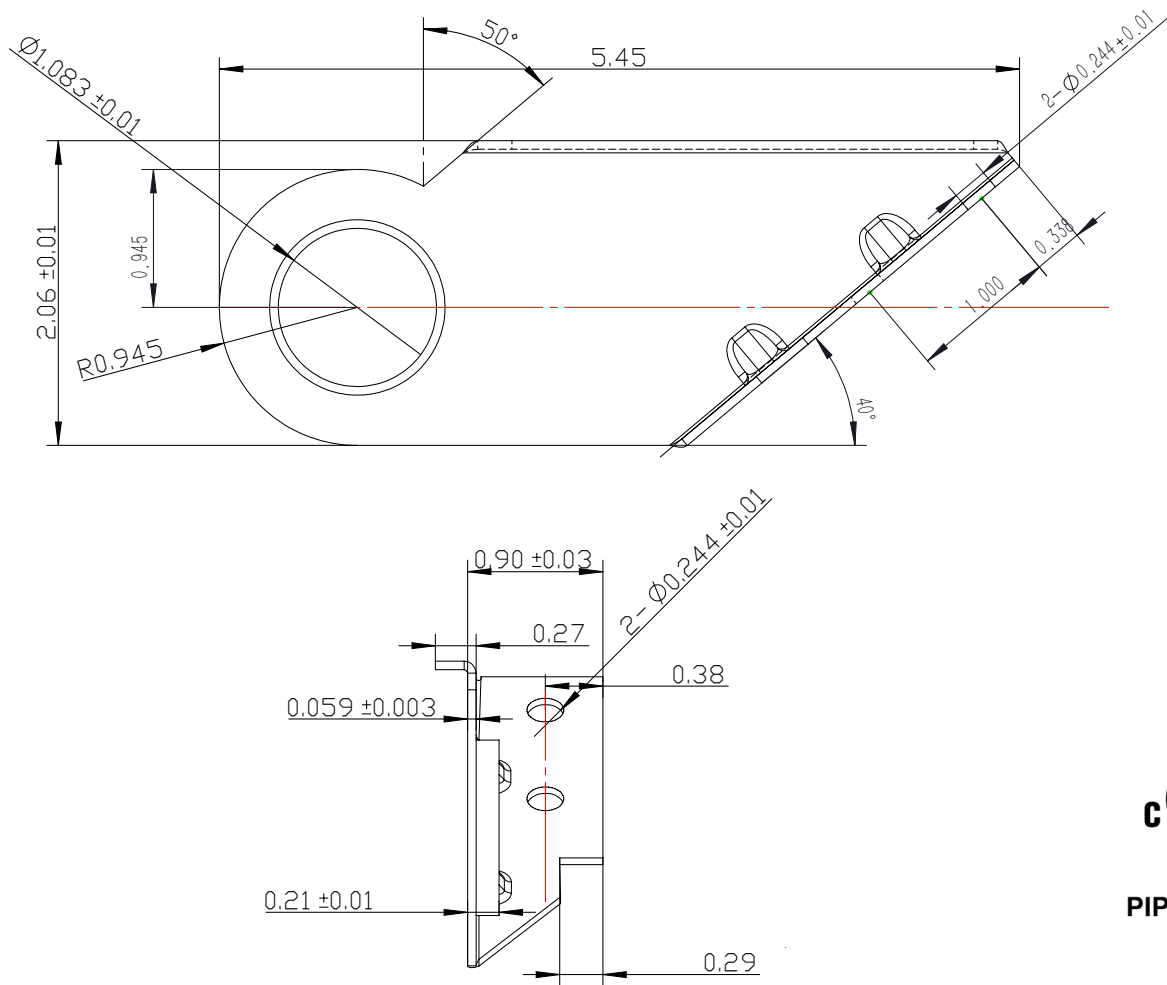


- Material: ASTM A366, Q/MGB578 Commercial Grade Carbon Steel 0.559"
- Plating: Electro Galvanized Zinc 0.0005"
- Tolerance:
 - Linear ±0.02"
 - Angular ±5°
- Tensile Strength: 217 Mpa
- Yield Strength: 329 Mpa

System No.		Location		Spec Section		Paragraph	
Submitted By		Date		Approved		Date	

CPVC PIPE HANGER SUPPORT

DOUBLE OFFSET CPVC HANGER • 1" SIZE

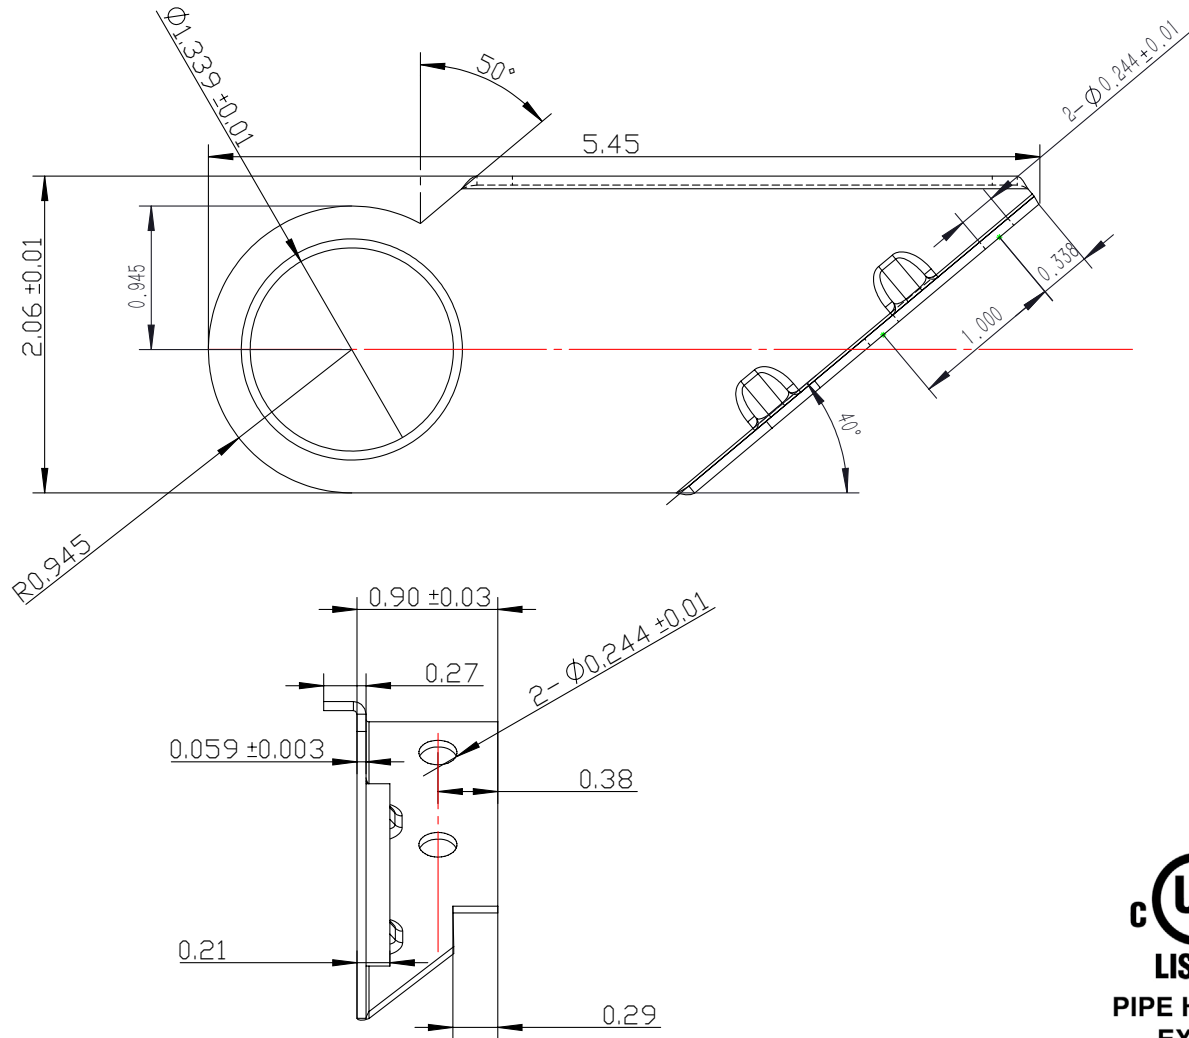

- Material: ASTM A366, Q/MGB578 Commercial Grade Carbon Steel 0.559"
- Plating: Electro Galvanized Zinc 0.0005"
- Tolerance:
 - Linear ± 0.02 "
 - Angular $\pm 5^\circ$
- Tensile Strength: 217 Mpa
- Yield Strength: 329 Mpa

System No.		Location		Spec Section		Paragraph	
Submitted By		Date		Approved		Date	

2024-12-03

MR. RUSSELL BRYANT
ALLIED RUBBER & GASKET CO INC, DBA ARGCO
5400 S 66th St
Fort Smith, AR, 72903, US

Notice of Completion (NoC) and authorization to apply the UL Mark

Your reference:

Our reference: File EX6587, Volume 1

Order: 15403300

Project: 4791407982

Project scope: New Hanger Submission: CPVC Offset Hanger for vertical and horizontal installation, File EX6587

Dear Mr. Russell Bryant:

We appreciate that you have a choice of certification providers and thank you for choosing UL Solutions. We have completed the investigation under the above project and confirmed compliance of your product(s) with UL Mark requirements.

This letter temporarily supplements the UL Follow-Up Services Procedure and serves as authorization to apply the UL Mark at the factory location(s) identified on the Authorization Page of UL Solutions File EX6587, Volume 1. You are required to send a copy of this letter to all manufacturing locations authorized under UL Solutions File EX6587, Volume 1.

The Follow-Up Services Procedure covering your product(s) will typically be provided by UL Solutions within 10 business days. Any information and documentation provided to you involving the UL Mark services are provided on behalf of UL LLC or any authorized licensee. The UL Solutions certification directory is updated with active certifications shortly after projects are reviewed and completed. Please visit <https://productiq.ulprospector.com/> to search for the certification.

Products that bear the UL Mark must be identical to those submitted to UL for evaluation and certification and must comply with the Follow-Up Services Procedure covering your product(s). Additional requirements related to the responsibilities of the Applicant and Manufacturer can be found under **Customer Requirements documents** at www.ul.com/fus.

A UL Solutions certification is a valuable marketing tool meaning your product or company has successfully met stringent requirements. We encourage you to use your UL Mark and certification in your marketing activities. We are happy to provide guidance on how best to promote your UL certification. Our [Certification Achievement Kit](#) demonstrates marketing and promotional concepts to help you best represent your UL certification.

UL Solutions is committed to providing you with an exceptional customer experience. You may receive an email from ULSurvey@feedback.ul.com inviting you to provide feedback. Your survey rankings and comments regarding the experience are important to us. We are always seeking ways to improve in any areas we can, and your feedback and comments are vital to this process.

If you have any questions, please contact me or any of our customer service representatives at www.ul.com/contact-us.

Sincerely,

Andrew Gurvey
Senior Engineering Associate
UL Solutions
Andrew.J.Gurvey@ul.com

David Piecuch
UL Mark Certification Program Manager
UL LLC
David.Piecuch@ul.com

fd8e2801e5af47b7b0982bdad6d9adf4